


PLAN VIEW

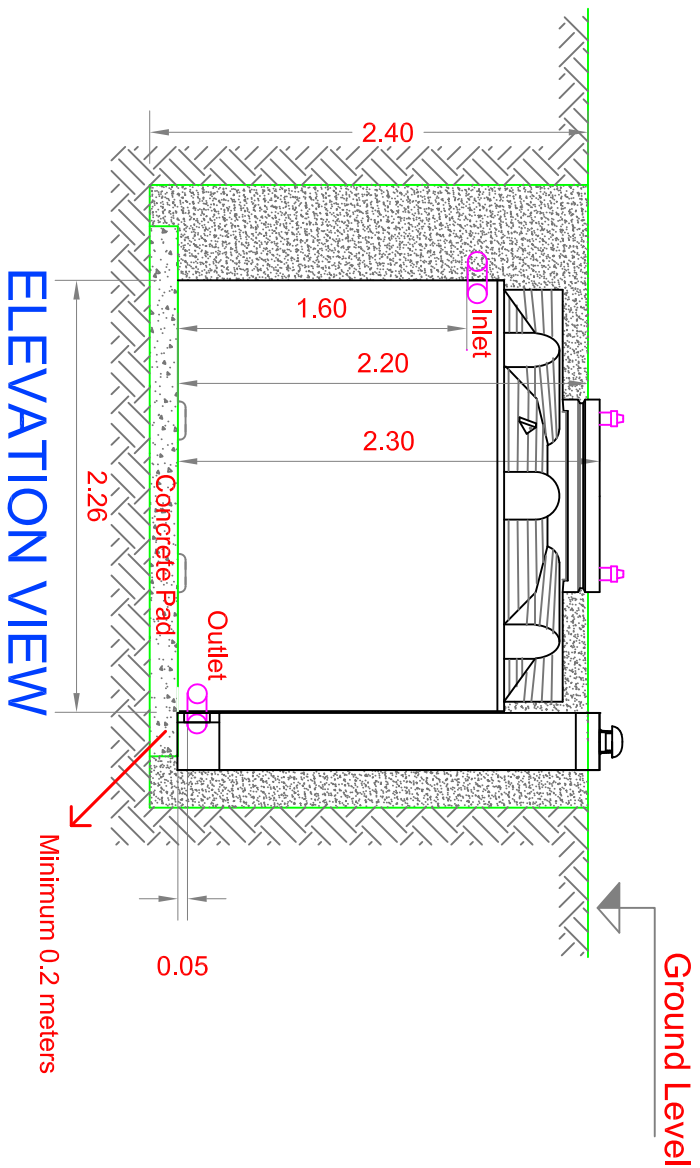

ELEVATION VIEW

Notes:

- 1- Unless otherwise specified, all dimensions are in meters.
- 2 - For electrical wiring, 1 cable 3x2.5 mm² is required from main electrical panel to the T.Plant optional lifting station.
- 3 - 4" ventilation (odor) ducts from the inlet pipe is required: duct outlet at 1.5 m above the roof of the building.
- 4- Access to the plant must be provided to empty the settlement compartments once per year.

Plant Capacity:

Inhabitant equivalent: 5 IE

Daily flow: 0.75 m³



TREATMENT PLANT
TYPE N-ECO 5

CONTACT:
T. +961 4 925 000
www.nassar.group.com

SCALE:
NTS